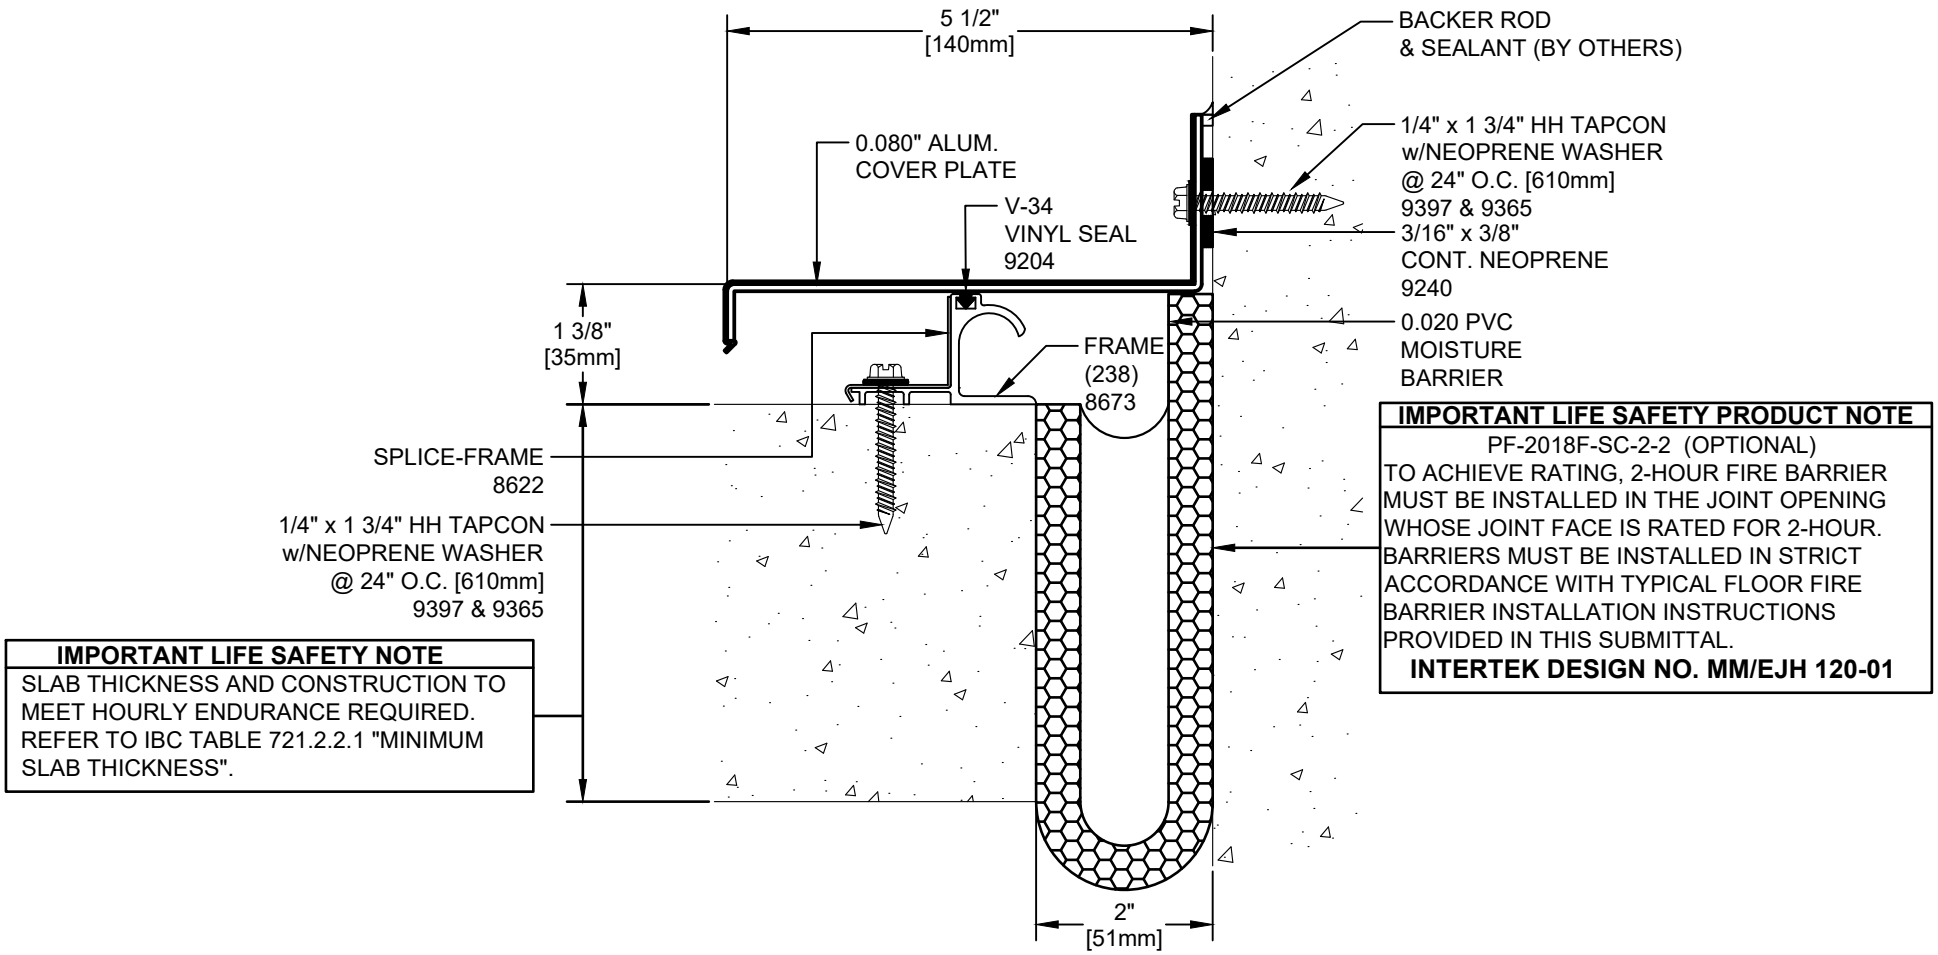

IMPORTANT LIFE SAFETY NOTE

SLAB THICKNESS AND CONSTRUCTION TO MEET HOURLY ENDURANCE REQUIRED. REFER TO IBC TABLE 721.2.2.1 "MINIMUM SLAB THICKNESS".

IMPORTANT LIFE SAFETY PRODUCT NOTE

PF-2018F-SC-2-2 (OPTIONAL)
TO ACHIEVE RATING, 2-HOUR FIRE BARRIER MUST BE INSTALLED IN THE JOINT OPENING WHOSE JOINT FACE IS RATED FOR 2-HOUR. BARRIERS MUST BE INSTALLED IN STRICT ACCORDANCE WITH TYPICAL FLOOR FIRE BARRIER INSTALLATION INSTRUCTIONS PROVIDED IN THIS SUBMITTAL.

INTERTEK DESIGN NO. MM/EJH 120-01

Model	Nominal "JT"	Joint Opening "JT"				Total Movement	Mat. Code
		Seismic Min.	Thermal Min.	Thermal Max.	Seismic Max.		
WJL-2-2	2"	0.0"	1.5"	2.5"	4"	4"	EJMR1504
WJL-2-2 w/ PF-2018F-SC-2-2	2"	0.875"	1.5"	2.5"	4"	3.125"	EJMR1504

Representative:	Customer:	Project:	Location:	Project Number:

MM SYSTEMS

50 MM WAY
PENDERGRASS, GA. 30567
PHONE: 706-824-7500
800-241-3460
FAX: 706-824-7501

www.mmsystemscorp.com

For Spec-Data, Installation Guides, or movement requirements, contact MMSC

Model: *WJL-2-2*

Drawn by:	Scale:	Drawing Number:
BOO	NTS	EJMR1504
SHT. 1 OF 1	Issue Date: 12-17-18	