


IMPORTANT LIFE SAFETY NOTE
 SLAB THICKNESS AND CONSTRUCTION TO MEET HOURLY ENDURANCE REQUIRED. REFER TO IBC TABLE 721.2.2.1 "MINIMUM SLAB THICKNESS".

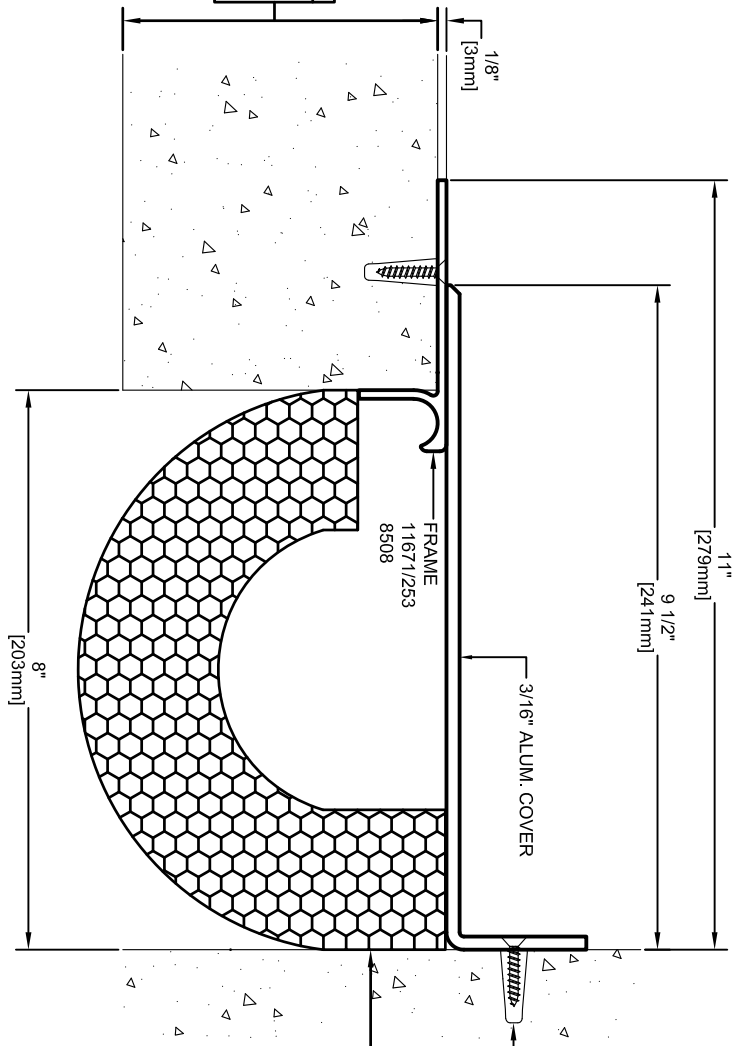

IMPORTANT LIFE SAFETY PRODUCT NOTE
 PF-2018F-SC-8-2 (OPTIONAL)
 TO ACHIEVE RATING, 2-HOUR FIRE BARRIER MUST BE INSTALLED IN THE JOINT OPENING WHOSE JOINT FACE IS RATED FOR 2-HOUR. BARRIERS MUST BE INSTALLED IN STRICT ACCORDANCE WITH TYPICAL FLOOR FIRE BARRIER INSTALLATION INSTRUCTIONS PROVIDED IN THIS SUBMITTAL.
INTERTEK DESIGN NO. MME/EJH 120-01

#10-12 X 1" ANCHOR
 (PLASTIC INSERT)
 & #10 X 1" FHSM/SS
 @ 24" O.C. [610mm]
 9357 & 9351

Model	Nominal "JT"	Seismic Min	Thermal Min	Thermal Max	Seismic Max	Total Movement	Mat. Code
ASJE-8-2	8"	1"	7"	9"	10.75"	9.75"	
ASJE-8-2 w/ PF-2018F-SC-8-2	8"	3.5"	7"	9"	10.75"	7.25"	

USE WITH ASJ-8-4

Representative: _____ Customer: _____ Project: _____ Location: _____ Project Number: _____

RIGHTS OF DESIGN
 All rights of design, detail, engineering and/or invention contained herein are the property of MMS Systems Corporation and hereby reserved and are not to be reproduced or provided to any other party. MMS Systems Corporation reserves the right to amend or withdraw any information contained herein without notice and will not be liable for any inaccuracy or ambiguity of said information.

50 MM WAY
PENDERGRASS, GA. 30567
PHONE: 706-824-7500
800-241-3460
FAX: 706-824-7501

MM SYSTEMS
www.mmsystemscorp.com

For Spec-Data, Installation Guides, or movement requirements, contact MMSC

Model: _____
 Drawn by: **CEL**
 SHT. OF .
 Scale: **NTS**
 Issue Date: **12-06-17**
ASJE-8-2
 Drawing Number: _____

