


IMPORTANT LIFE SAFETY PRODUCT NOTE
 PF-2018CW-SC-3-1.5
 TO ACHIEVE RATING, 2-HOUR FIRE BARRIER
 MUST BE INSTALLED IN 2-HOUR RATED WALL.
 BARRIERS MUST BE INSTALLED IN STRICT
 ACCORDANCE WITH TYPICAL WALL FIRE
 BARRIER INSTALLATION INSTRUCTIONS
 PROVIDED IN THIS SUBMITTAL.


* CONTACT FACTORY FOR OTHER STYLES OF FIRE BARRIER

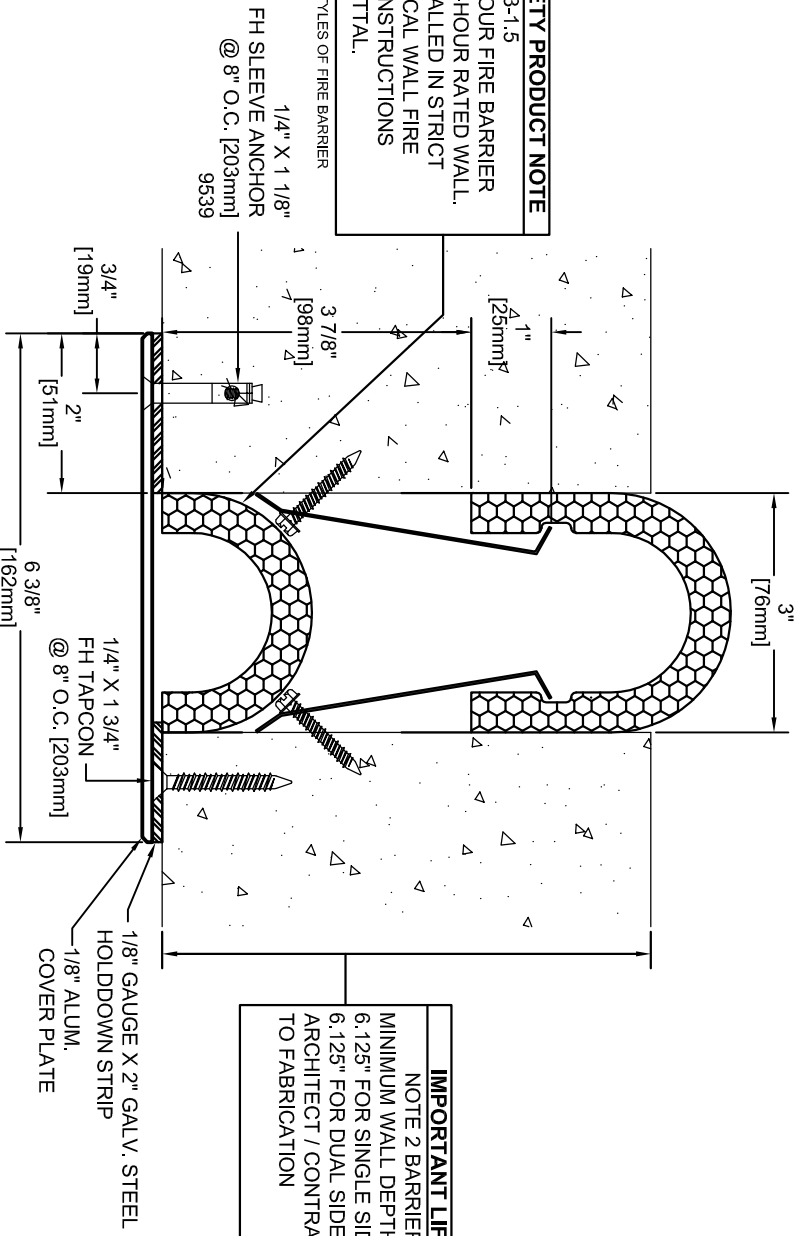

IMPORTANT LIFE SAFETY NOTE
 NOTE 2 BARRIERS REQUIRED.
 MINIMUM WALL DEPTH REQUIRED FOR RATING:
 6.125" FOR SINGLE SIDE INSTALLATION (SHOWN)
 6.125" FOR DUAL SIDE INSTALLATION
 ARCHITECT / CONTRACTOR MUST VERIFY PRIOR
 TO FABRICATION

Model	SP-3-1.5 CONC_WPF	Nominal "JT"	3"	Joint Opening "JT"		Total	Mat. Code
		Seismic Min.	0.875"	Thermal Min.	2.25"	Seismic Max.	4.25"
				Thermal Max.	3.75"	Movement	3.375"
							SM1912

Representative: _____ Customer: _____ Project: _____ Location: _____ Project Number: _____



MM
 MM SYSTEMS

50 MM WAY
 PENDERGRASS, GA. 30567
 PHONE: 706-824-7500
 800-241-3460
 FAX: 706-824-7501

www.mmssystemscorp.com

For Spec-Data, Installation Guides, or movement requirements, contact MMISC

RIGHTS OF DESIGN

All rights of design, detail, engineering and/or invention contained herein are the property of MM Systems Corporation and hereby reserved and are not to be reproduced or provided to any other party. MM Systems Corporation reserves the right to amend or withdraw any information contained herein without notice and will not be liable for any inaccuracy or ambiguity of said information.

Model: **SP-3-1.5 CONC_WPF**

Drawn by: LMP

Scale: NTS

Drawing Number: SM1912

SHT. . OF .
 Issue Date: 02-10-10